Locker and changing room *dimensions*

Locker, bench, hook and clear-space figures from Sport England and Approved Document M, with the source of each. Locker depth is not set by any source we read.


Compliance guidance. Figures are taken from Sport England's Accessible Sports Facilities guidance (2010, April Revision 003) and Approved Document M volume 2 (2015 edition incorporating the 2020 and 2024 amendments), read on 8 November 2026. Sport England guidance is advisory and written for sports buildings; Approved Document M is England only. BS 8300-2:2018 was not read. This is guidance, not legal or accessibility advice; confirm with an access consultant and building control. The studio does not claim that it or its partner workshops supply any particular locker system.

AT A GLANCE

Item	Figure	Source	Note
Locker reach range	Enough lockers set between 450 and 900 mm high; at least 300 mm wide	SE p.38	Heights from the floor.
Sports-bag and full-height lockers	Some 400 mm wide; 10% full height, at least 1,800 mm high	SE p.38	For mobility aids.
Locks and numbers	Locks 1,150 mm above floor at most; numbers embossed and visible	SE p.38	Upper stacked tiers excepted.
Space in front of lockers	1,500 mm deep manoeuvring space	ADM2 5.18(j)	Changing areas.
Bench	Seat 450 mm high, 450 deep at least (500 preferred); assisted-change bench 600 deep × 2,000 long	SE p.38	Fig 16 key says 480 high.
Coat hooks	Alternate at 1,050 and 1,400 mm	SE p.38	Child and wheelchair reach.
Between seating and cubicles	1,500 mm minimum; door opening 875 clear	SE Fig 15	Tennis: 1,000.
Wet and dry floor	No upstand; falls 1:35 to 1:50; slip resistant	SE; ADM2 5.18(i)	Distinct wet and dry areas (ADM2 5.16).

SE = Sport England, Accessible Sports Facilities, 2010, April Revision 003 (advisory). ADM2 = Approved Document M volume 2, 2015 edition incorporating 2020 and 2024 amendments (England). Read 8 November 2026.

Heights in mm above the floor. Sport England Accessible Sports Facilities (2010).

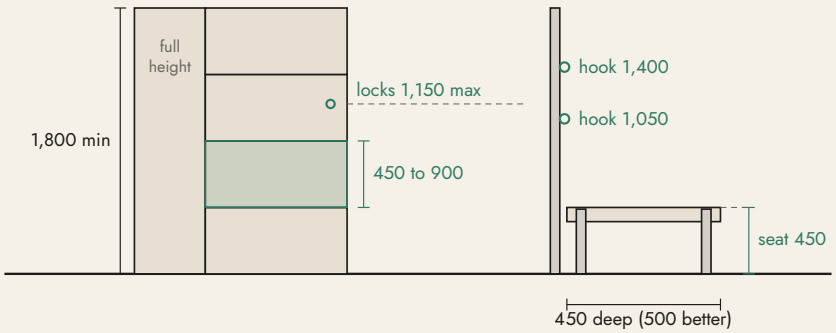

Locker bank and bench with the heights Sport England prints for accessible provision, in mm above the floor. Original drawing by Make Bespoke Studio, not a construction drawing.

SPECIFICATION WORDING

LOCKER BANK

Lockers [nr] in [nr] banks, doors in tiers with the accessible tier set between [450] and [900] mm above finished floor, each at least [300] mm wide; [10] per cent full height, not less than [1,800] mm; [nr] at [400] mm wide for sports bags. Locks not higher than [1,150] mm above finished floor, operable with one hand without tight grasping, pinching or twisting; locker and lock numbers embossed. Depth [ ] mm to the operator's brief. Locker bank elevation to show every dimension.

BENCH AND HOOKS

Fixed bench, seat [450] mm above finished floor, not less than [450] mm deep ([500] preferred), with rounded edges and a smooth finish; [one] length of [600] × [2,000] mm for assisted changing. Coat hooks alternate at [1,050] and [1,400] mm above finished floor. A clear [1,500 × 1,500] mm manoeuvring space to be kept in front of lockers and benches.

CHANGING FLOOR EDGE

Level threshold between changing and shower areas with no upstand; floor to shower area laid to falls between [1:50] and [1:35] to a drain, slip-resistant when wet; permanent inset matting at the wet and dry edge. Joinery bases and plinths in the wet zone to be [moisture-resistant material, finish] and sealed to the floor.

TERMS USED

Full-height locker

A locker at least 1.8 m high, provided in Sport England guidance for about ten per cent of lockers so that mobility aids such as crutches can be stored.

Manoeuvring space

The clear floor area, 1,500 × 1,500 mm in the Sport England changing-room figures, needed for a wheelchair user to turn and approach lockers or a bench.

Wet and dry zones

The shower or wet area and the changing area beside it. Approved Document M asks for a combined facility to be divided into distinct wet and dry areas.

STANDARDS AND SOURCES

- Sport England, Accessible Sports Facilities (Design Guidance Note, updated 2010, April Revision 003): advisory; read from a hosted copy; confirm the current edition.
- Approved Document M volume 2: 2015 edition incorporating 2020 and 2024 amendments; 3.14, 5.15 to 5.18, Diagram 22. Read.
- BS 8300-2:2018: status not re-checked this session. Not read.

Full guide: https://makebespoke.com/trade/technical/locker-and-changing-room-dimensions. Make Bespoke Studio coordinates manufacture through its partner workshops. Figures are guidance only and your specification governs; some may be superseded, so contact the studio to verify.